

EARTH-LEAKAGE CIRCUIT BREAKERS INSTRUCTION MANUAL

Types NV400-SEW, NV400-HEW, NV400-REW
NV630-SEW, NV630-HEW
NV800-SEW, NV800-HEW, NV800-SEWL

1. Before using

- Please peruse this instruction manual before using.
- Please handle this product by skilled or instructed person.

2. Caution for handlings



- Connect a suitable electric wire for the rated current to line side and load side.
- In the case of single-phase two-wire system, connect the electric wire to the right and the left pole.
- In the case of single-phase three-wire system, connect the neutral to the center pole of circuit breaker.
- In the case of three-phase four-wire system, connect the neutral wire to the neutral pole of circuit breaker.

3. Caution concerning usage

- Before starting to use, check operation of this product by pushing the Test button. Unless voltage is impressed, Test button dose not function.

4. Setting method of the operating characteristics


CAUTION
Before setting, turn off the upper circuit breaker, or turn off the circuit breaker to be set or trip the breaker, then make sure of no current conducting.

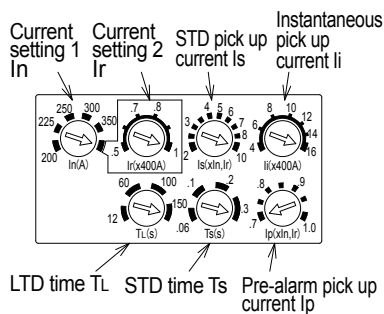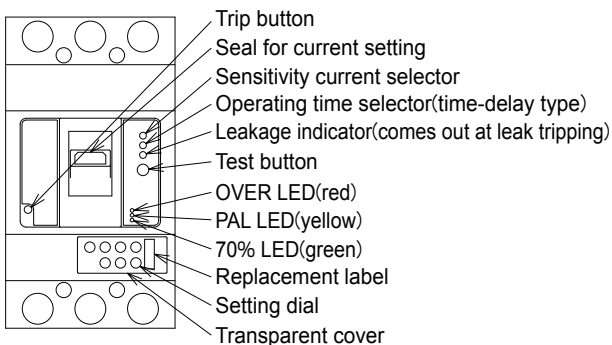


Step adjustable:
Current setting 1 I_n ,
LTD time T_L ,
STD pick up current I_s ,
STD time T_s ,
Pre-alarm pick up current I_p


Continuously adjustable:
Current setting 2 I_r , (Note 1)
Instantaneous pick up current I_i

- Open the transparent cover.
- Set operating characteristics by turning the dials.
A slotted head screwdriver of 4.5mm width and 0.6mm thickness at the top is suitable for the setting.
Please operate the dials by the power less than 0.5N·m. Otherwise, characteristics setting device may be broken.
Please set the step adjustable dials by the scale.
Otherwise, characteristic is not set up correctly.
As for I_s setting, a set value may advance to the next one in some causes.
In case of LTD time $T_L=12s$, the LTD time may be shorter than the STD time.
- The blank labels may be used for indication of the current setting.
Please fill in the blank label with oily ink, and stick the label to the top of the handle.
- Close the transparent cover.



Note 1) Current setting 2 I_r becomes effective when current setting 1 I_n is set at maximum.


Example 1  Current setting 1 : Maximum
Current setting 2 : 0.7
Current setting : 280A(=400A×0.7)

Example 2  Current setting 1 : 250A
Current setting 2 : 0.7 ← Not effective
Current setting : 250A


5. Testing method

Check operation with load current or using the breaker tester "Y-250"(option).
If the breaker tester "Y-250" is used, execute the test according to its manual.

- Apply AC current to the circuit-breaker from three-phase or single-phase power supply.
In case of single-phase power supply, apply the current with any two poles in series.

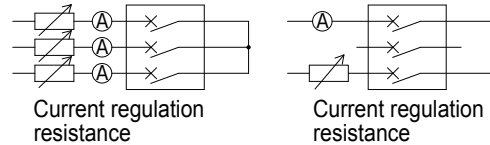

- Check following items by each LED in front of circuit breaker.
OVER LED(red) : LED lights among 105 to 125% of current setting.
PAL LED(yellow) : In case of Pre-alarm pick up current $I_p=0.7$, LED blinks among 60 to 80% of current setting.
70% LED(green): LED lights among 60 to 80% of current setting.
- LTD and pre-alarm operating time can be checked by load current equivalent to 200% of the current setting. If operating current of circuit breaker is measured just before this test, operating time is shorter. In this case, please measure again after circuit breaker is tripped.

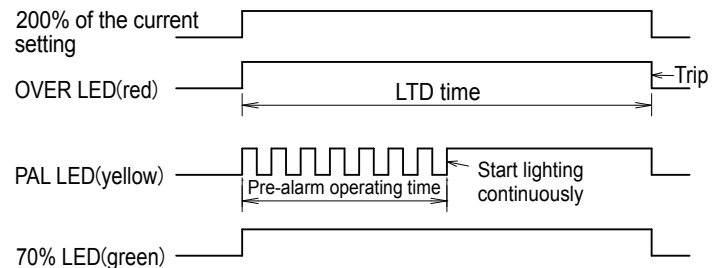

The result is good if the operating time measured falls within the following range.

| Setting of LTD time T_L | $T_L=12s$ | $T_L=60s$ | $T_L=100s$ | $T_L=150s$ |
|---------------------------|-----------|-----------|------------|------------|
| Pre-alarm operation time | 4.8~7.2s | 24~36s | 40~60s | 60~90s |
| LTD operating time | 9.6~14.4s | 48~72s | 80~120s | 120~180s |